



# THREE OAKS RENEWABLE ENERGY PARK

## Typical Transformer Container


Figure 6

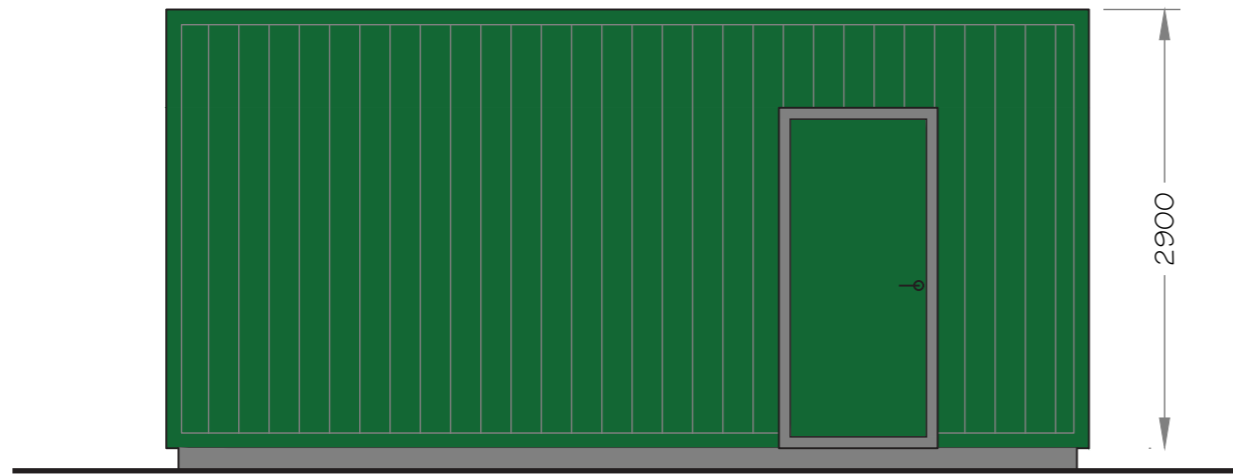

Side elevation

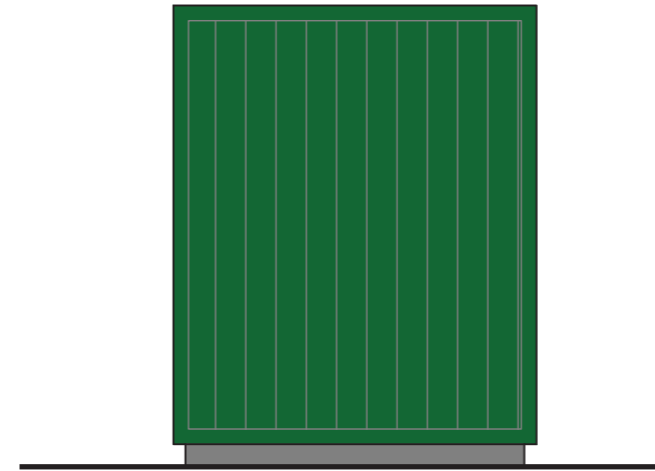

End elevation

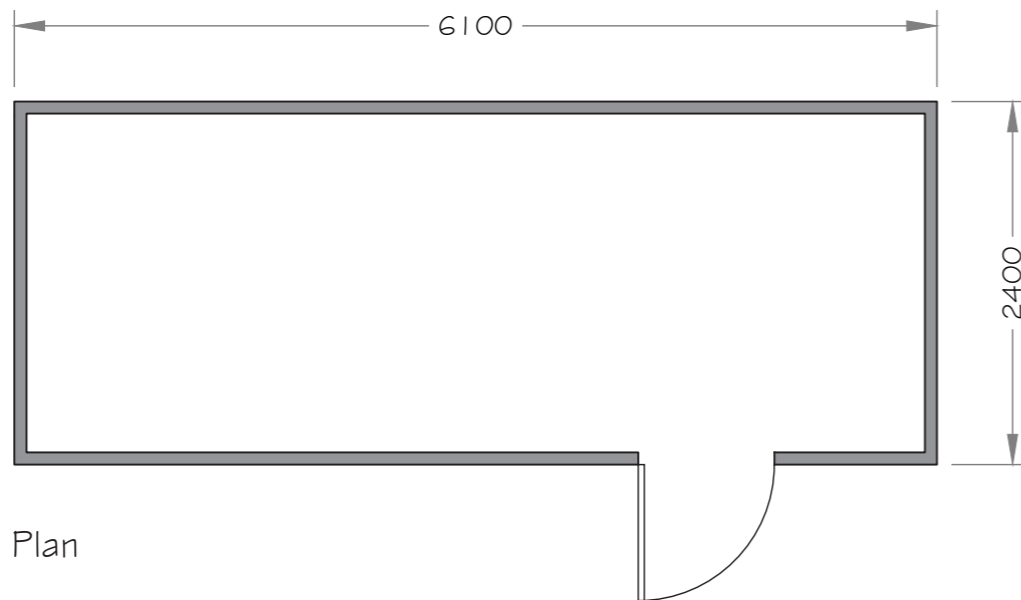

Plan

### NOTES

- 1 All measurements in millimetres, unless stated otherwise
- 2 Door arrangement and ventilation may vary
- 3 External finishes to be agreed with the LPA prior to construction
- 4 Built off 150mm high plinth